


Tank Heater Units


FOR IMMERSION HEATING
OF WATER IN STORAGE TANKS

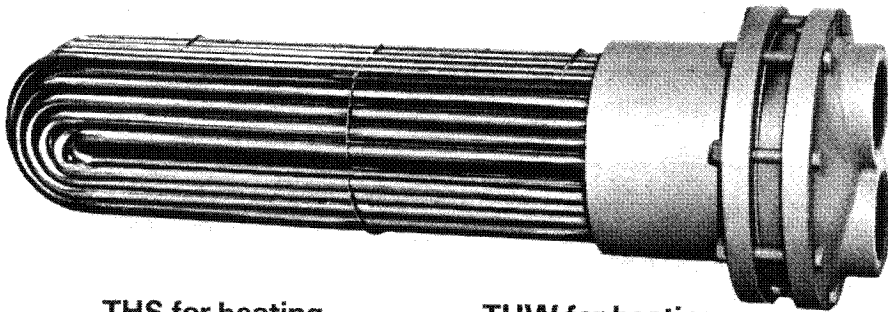

THS for heating
with steam

THW for heating
with boiler water

SIZES — CAPACITIES — DIMENSIONS

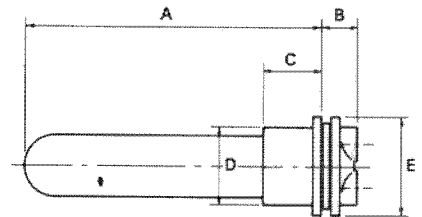

For dimensions
see table

Heater Number THW Using Boiler Water THS Using Steam	Capacities in U.S. Gals. per Hr. Heating Tank Water 40° to 140°F. with Boiler Water		Dimensions in inches					NPT HEAD CONNECTIONS (in inches)			Heating Surface Sq. Ft.	
	180°F. Gravity	180°F. Pumped	A	B	C	D	E	THS				
								Stm.	Cond.	THW In & Out		
THW - THS - 412	20	32	12									1.5
418	30	48	18									2.3
424	40	64	24									3.1
430	50	80	30									3.9
436	60	96	36	2 3/4	6	4 1/2	7 1/4	1 1/4	3/4	1 1/4		4.7
448	80	128	48									6.2
460	100	168	60									7.8
472	120	186	72									9.4
484	140	232	84									10.9
496	160	280	96									12.5
THW - THS - 612	48	77	11 1/4									3.5
618	68	108	17 1/4									5.4
624	86	138	23 1/4									7.6
630	106	170	29 1/4									9.4
636	124	198	35 1/4	3 3/8	6 1/2	6 5/8	10 1/2	2	1	2		11.5
648	164	262	47 1/4									15.3
660	202	324	59 1/4									19.3
672	240	384	71 1/4									23.1
684	280	450	83 1/4									27.1
696	318	510	95 1/4									31.0
THW - THS - 824	127	279	24									15.0
830	195	353	30									19.0
836	264	427	36									23.0
842	308	500	42									27.0
848	350	560	48	4 1/4	8	8 5/8	12 1/2	3	1 1/4	3		31.0
860	408	655	60									38.0
872	500	805	72									46.0
884	588	930	84									54.0
896	665	1070	96									62.0
THW - THS - 1030	430	690	30									35.5
1036	510	820	36									43.0
1042	603	965	42									50.5
1048	698	1120	48									58.0
1060	872	1398	60	5	8 1/2	10 5/8	14 3/8	4	2	4		73.0
1072	1045	1670	72									88.0
1084	1190	1910	84									102.0
1096	1360	2190	96									117.0
10108	1535	2460	108									132.0
THW - THS - 1236	710	1136	36									61.0
1242	835	1338	42									72.0
1248	950	1540	48									83.0
1254	1070	1742	54									94.0
1260	1190	1944	60	5 5/8	10	12 3/8	16 3/8	4	2	4		104.0
1272	1425	2348	72									126.0
1284	1660	2752	84									147.0
1296	1900	3156	96									169.0
12108	2140	3560	108									191.0
12120	2380	3964	120									212.0
THW - THS - 1436	970	1535	36									83.0
1442	1130	1797	42									98.0
1448	1290	2060	48									112.0
1454	1455	2330	54									127.0
1460	1620	2605	60	6 1/2	10 1/2	14	17 1/2	6	3	6		142.0
1472	1940	3120	72									171.0
1484	2260	3670	84									200.0
1496	2580	4220	96									230.0
14108	2900	4750	108									259.0
14120	3240	5310	120									289.0

MAXIMUM RECOMMENDED FLOW OF BOILER WATER THROUGH TANK HEATERS

Size	4"	—	27 USGPM
	6"	—	69 "
	8"	—	135 "
	10"	—	260 "
	12"	—	375 "
	14"	—	510 "

At these flows, pressure drop through the heaters may be approximated as 0.6 ft. head per foot of length.

STANDARD MATERIALS OF CONSTRUCTION

Tubing: 3/4" O.D. #18
BWG copper
Tubesheet: carbon steel
Tube supports: brass
Head: cast iron

STANDARD DESIGN PRESSURES

4"	—	150 psig	10"	—	125 psig
6"	—	150 psig	12"	—	125 psig
8"	—	150 psig	14"	—	125 psig

Units with special materials, higher design pressures or in larger sizes are available.

NOTES:

(1) Capacities given for Tank Heaters may be used when tanks have a capacity at least equal to the hourly demand. For other conditions, consult with Armstrong representative.

(2) Capacities given do not incorporate allowances for fouling or scaling. Extra length of Heater should be provided if needed, according to water conditions.

(3) It is recommended a vacuum breaker and air vent be installed on all heaters used on steam pressure systems. Tappings are provided in heater head for this purpose.

For higher temperature boiler water, or when using steam as heating medium, see reverse side for capacity factors.

THW and THS Tank Heater Units

SELECTION DATA

CAPACITY FACTORS TO BE USED FOR VARIOUS BOILER WATER TEMPERATURES AND STEAM PRESSURES

Tank Water Temp. Rise °F.		PUMPED BOILER WATER INLET TEMP. °F.							STEAM PRESSURE AT HEATER (PSIG)									
		With 20° Temp. Drop					40° Temp. Drop		0#	2	5	10	15	25	50	75	100	
		180	200	210	220	240	220	240	212 °F	218 °F	227 °F	240 °F	250 °F	267 °F	298 °F	321 °F	338 °F	
From	To																	
	100	2.33	2.87	3.10	3.36	3.87	3.12	3.63	3.80	4.12	4.24	4.50	4.78	5.25	5.95	6.88	7.70	
	120	1.54	1.94	2.11	2.30	2.67	2.11	2.47	2.84	3.08	3.17	3.37	3.58	3.92	4.45	5.15	5.75	
40	140	1.00	1.20	1.50	1.64	1.96	1.49	1.80	2.28	2.40	2.48	2.73	2.91	3.25	3.90	4.32	4.55	
	160	0.57	0.91	1.07	1.21	1.46	1.05	1.32	1.63	1.78	1.91	2.08	2.28	2.54	3.03	3.45	3.67	
	180	—	0.55	0.70	0.85	1.11	0.68	0.97	1.19	1.30	1.47	1.75	1.82	2.05	2.54	2.84	3.06	
	200	—	—	—	0.52	0.80	—	0.65	0.75	0.87	1.09	1.30	1.39	1.61	2.05	2.35	2.56	
	100	2.73	3.33	3.60	3.92	4.51	3.61	4.21	4.59	4.78	4.98	5.66	5.85	6.52	7.84	8.68	9.10	
	120	1.67	2.12	2.34	2.55	2.97	2.36	2.71	3.27	3.41	3.55	4.03	4.17	4.65	5.58	6.18	6.50	
50	140	1.06	1.43	1.49	1.77	2.10	1.55	1.93	2.54	2.65	2.76	3.13	3.24	3.61	4.33	4.80	5.05	
	160	0.57	0.95	1.11	1.26	1.55	1.10	1.40	1.82	1.98	2.04	2.31	2.42	2.74	3.34	3.76	3.92	
	180	—	0.58	0.73	0.88	1.14	0.70	1.00	1.24	1.40	1.51	1.78	1.94	2.18	2.69	2.96	3.18	
	200	—	—	—	0.53	0.82	—	0.66	0.80	0.93	1.16	1.38	1.48	1.72	2.19	2.51	2.73	
	100	3.26	4.00	4.38	4.74	5.51	4.33	5.09	5.78	5.98	6.22	7.07	7.30	8.15	9.80	10.85	11.40	
	120	1.85	2.40	2.63	2.88	3.39	2.61	3.12	3.80	3.97	4.14	4.71	4.85	5.42	6.50	7.20	7.56	
60	140	1.13	1.54	1.74	1.93	2.26	1.71	2.18	2.84	2.96	3.08	3.50	3.62	4.03	4.83	5.35	5.62	
	160	0.60	0.99	1.17	1.32	1.65	1.16	1.48	2.00	2.18	2.25	2.54	2.66	2.90	3.68	4.13	4.31	
	180	—	0.56	0.76	0.91	1.20	0.72	1.04	1.29	1.51	1.62	1.88	1.99	2.35	2.85	3.13	3.50	
	200	—	—	—	0.54	0.85	—	0.69	0.85	1.00	1.24	1.48	1.58	1.84	2.35	2.68	2.93	

The Capacity Factor 1.00 is for pumped boiler water entering at 180°F. to heat tank water from 40° to 140°F. To select a heater for other conditions, use the Factor in the table corresponding with the available heating medium. Divide the required capacity in USGPH by this Factor and, under the heater capacities given under the column "180°F. Boiler Water Pumped", choose the size of heater with a capacity equal to or greater than this figure.

Example: Select a heater to raise 2100 U.S. gals. per hour of water from 40°F. to 180°F., using steam entering the heater at 50 psig.

Solution: (a) From the above table, obtain a Capacity Factor of 2.54.

(b) Divide required capacity 2100 USGPH by 2.54 and obtain the figure 828.

(c) Under the Heater Capacity column for "180°F. Boiler Water Pumped", choose the heater size with a capacity equal to or greater than 828, which would be THS-884, or a shorter unit THS-1042. It is usually desirable to select a heater length at least one-half of the length of the tank in which it is installed.

BOILER WATER FLOW RATE

Boiler Water Minimum Pumping Rate is determined as follows:

Multiply capacity in USGPH by the required temperature rise °F. and divide by temperature drop in boiler water °F. x 60 to obtain pump capacity required in USGPM.

Example: To heat 1000 USGPH of water from 40°F. to 160°F. with boiler water entering at 200°F. and leaving at 180°F. would require a pumping rate of $1000 \times (160^\circ\text{F. minus } 40^\circ\text{F.}) / (200^\circ\text{F. minus } 180^\circ\text{F.}) \times 60 = 100 \text{ USGPM}$

S.A. Armstrong Limited
23 Bertrand Avenue
Toronto, Ontario
Canada, M1L 2P3
Tel: (416) 755-2291
Fax: (416) 759-9101

Armstrong Pumps Limited
Peartree Road, Stanway
Colchester, Essex
United Kingdom, C03 5JX
Tel: 01206-579491
Fax: 01206-760532



Armstrong Pumps Inc.
93 East Avenue
Buffalo, New York
U.S.A. 14120-6594
Tel: (716) 693-8813
Fax: (716) 693-8970

Armstrong Darling Inc.
2200 Place Transcanadienne
Montreal, Quebec
Canada, H9P 2X5
Tel: (514) 421-2424
Fax: (514) 421-2436